

DMX PLASTICS LIMITED

ACOUSTICAL PERFORMANCE TEST REPORT

SCOPE OF WORK

ASTM E90 AND ASTM E492 TESTING ON
DMX 1-STEP 2.0 UNDERLAYMENT WITH LUXURY VINYL PLANK

SPECIMEN TYPE

152 mm Concrete Slab with Drop Ceiling

REPORT NUMBER

L0679.04-113-11-R0

TEST DATE

06/13/20

ISSUE DATE

06/29/20

RECORD RETENTION END


06/13/24

PAGES

13

DOCUMENT CONTROL

ATI 00629 (03/21/18)
RTTDS-R-AMER-Test-2844
© 2017 INTERTEK

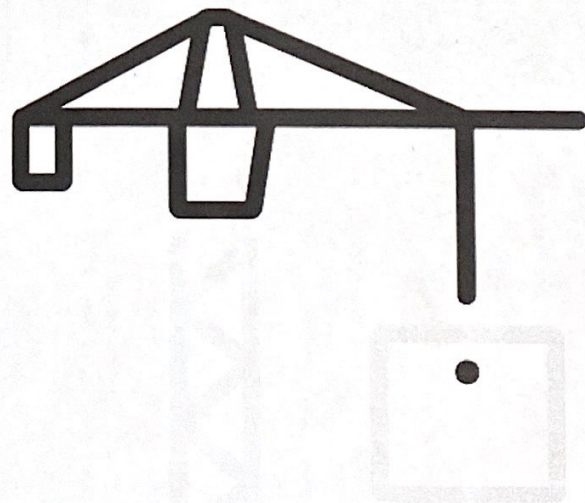



Total Quality. Assured.

130 Derry Court
York, PA 17406

Telephone: 717-764-7700
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR DMX PLASTICS LIMITED

Report No.: L0679.04-113-11-R0

Date: 06/29/20

REPORT ISSUED TO:

DMX PLASTICS LIMITED

165 Orenda Road

Brampton, Ontario L6W 1W3 CANADA

SECTION 1

SCOPE

Intertek Building & Construction (B&C) was contracted by DMX Plastics Limited to perform testing in accordance with ASTM E90 AND ASTM E492 on DMX 1-Step 2.0 Underlayment with Luxury Vinyl Plank. Results obtained are tested values and were secured by using the designated test methods. Testing was conducted in the VT test chambers at Intertek B&C located in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

SECTION 2

SUMMARY OF TEST RESULTS

DATA FILE NO.	L0679.04
SERIES/MODEL:	DMX 1-Step 2.0 Underlayment with Luxury Vinyl Plank
STC	62
IIC	72

COMPLETED BY: Seth J. Allen
Technician - Acoustical

TITLE: Testing

SIGNATURE: 
Digitally Signed by: Seth Allen

DATE: 06/29/20

COMPLETED BY: Daniel B. Mohler
Project Lead - Acoustical

TITLE: Testing

SIGNATURE: 
Digitally Signed by: Daniel Mohler

DATE: 06/29/20

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

