

DMX PLASTICS LIMITED

ACOUSTICAL PERFORMANCE TEST REPORT

SCOPE OF WORK

ASTM E90 AND ASTM E492 TESTING ON
5 MM CARPET OVER 8 MM DMX 1-STEP CARPET PAD

SPECIMEN TYPE

152 mm Concrete Slab with Suspended Ceiling

REPORT NUMBER

N2038.01-113-11-R1

TEST DATE

12/22/21

ISSUE DATE

01/12/22

REVISED DATE

01/13/22

RECORD RETENTION END

12/22/25

PAGES


15

DOCUMENT CONTROL

ATI 00629 (03/21/18)

RTTDS-R-AMER-Test-2844

© 2017 INTERTEK

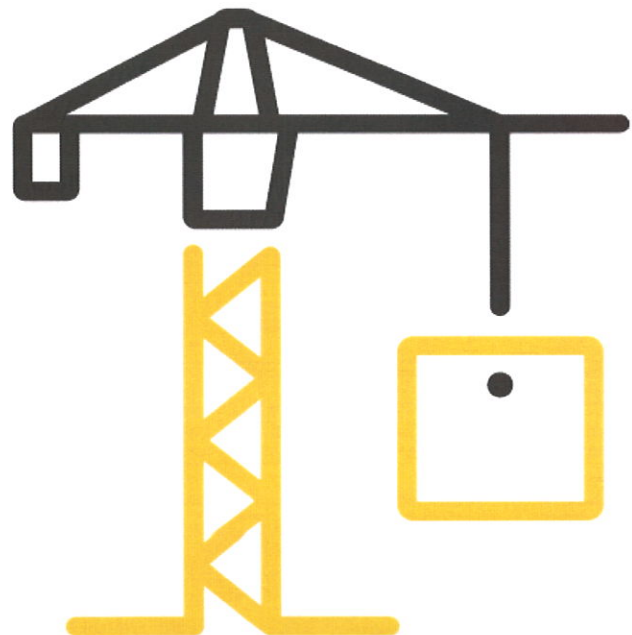

TEST REPORT FOR DMX PLASTICS LIMITED

Report No.: N2038.01-113-11-R1
Date: 01/13/22

REPORT ISSUED TO

DMX PLASTICS LIMITED
165 Orenda Road
Brampton, Ontario L6W 1W3 CANADA


SECTION 1
SCOPE


Architectural Testing, Inc. (an Intertek company) dba Intertek Building & Construction (B&C) was contracted by DMX Plastics Limited to perform testing in accordance with ASTM E90 AND ASTM E492 on 5 mm Carpet over 8 mm DMX 1-Step Carpet Pad. Results obtained are tested values and were secured by using the designated test methods. Testing was conducted in the VT test chambers at Intertek B&C located in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

SECTION 2
SUMMARY OF TEST RESULTS

DATA FILE NO.	N2038.01
SERIES/MODEL:	5 mm Carpet over 8 mm DMX 1-Step Carpet Pad
STC	62
IIC	79
HIIC	91

COMPLETED BY: Ronald J. Gover
Technician - Acoustical
TITLE: Testing
SIGNATURE: 
Digitally Signed for: Ron Gover by Janine Sobell
DATE: 01/13/22

COMPLETED BY: Daniel B. Mohler
Project Lead - Acoustical
TITLE: Testing
SIGNATURE: 
Digitally Signed by: Daniel Mohler
DATE: 01/13/22

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

